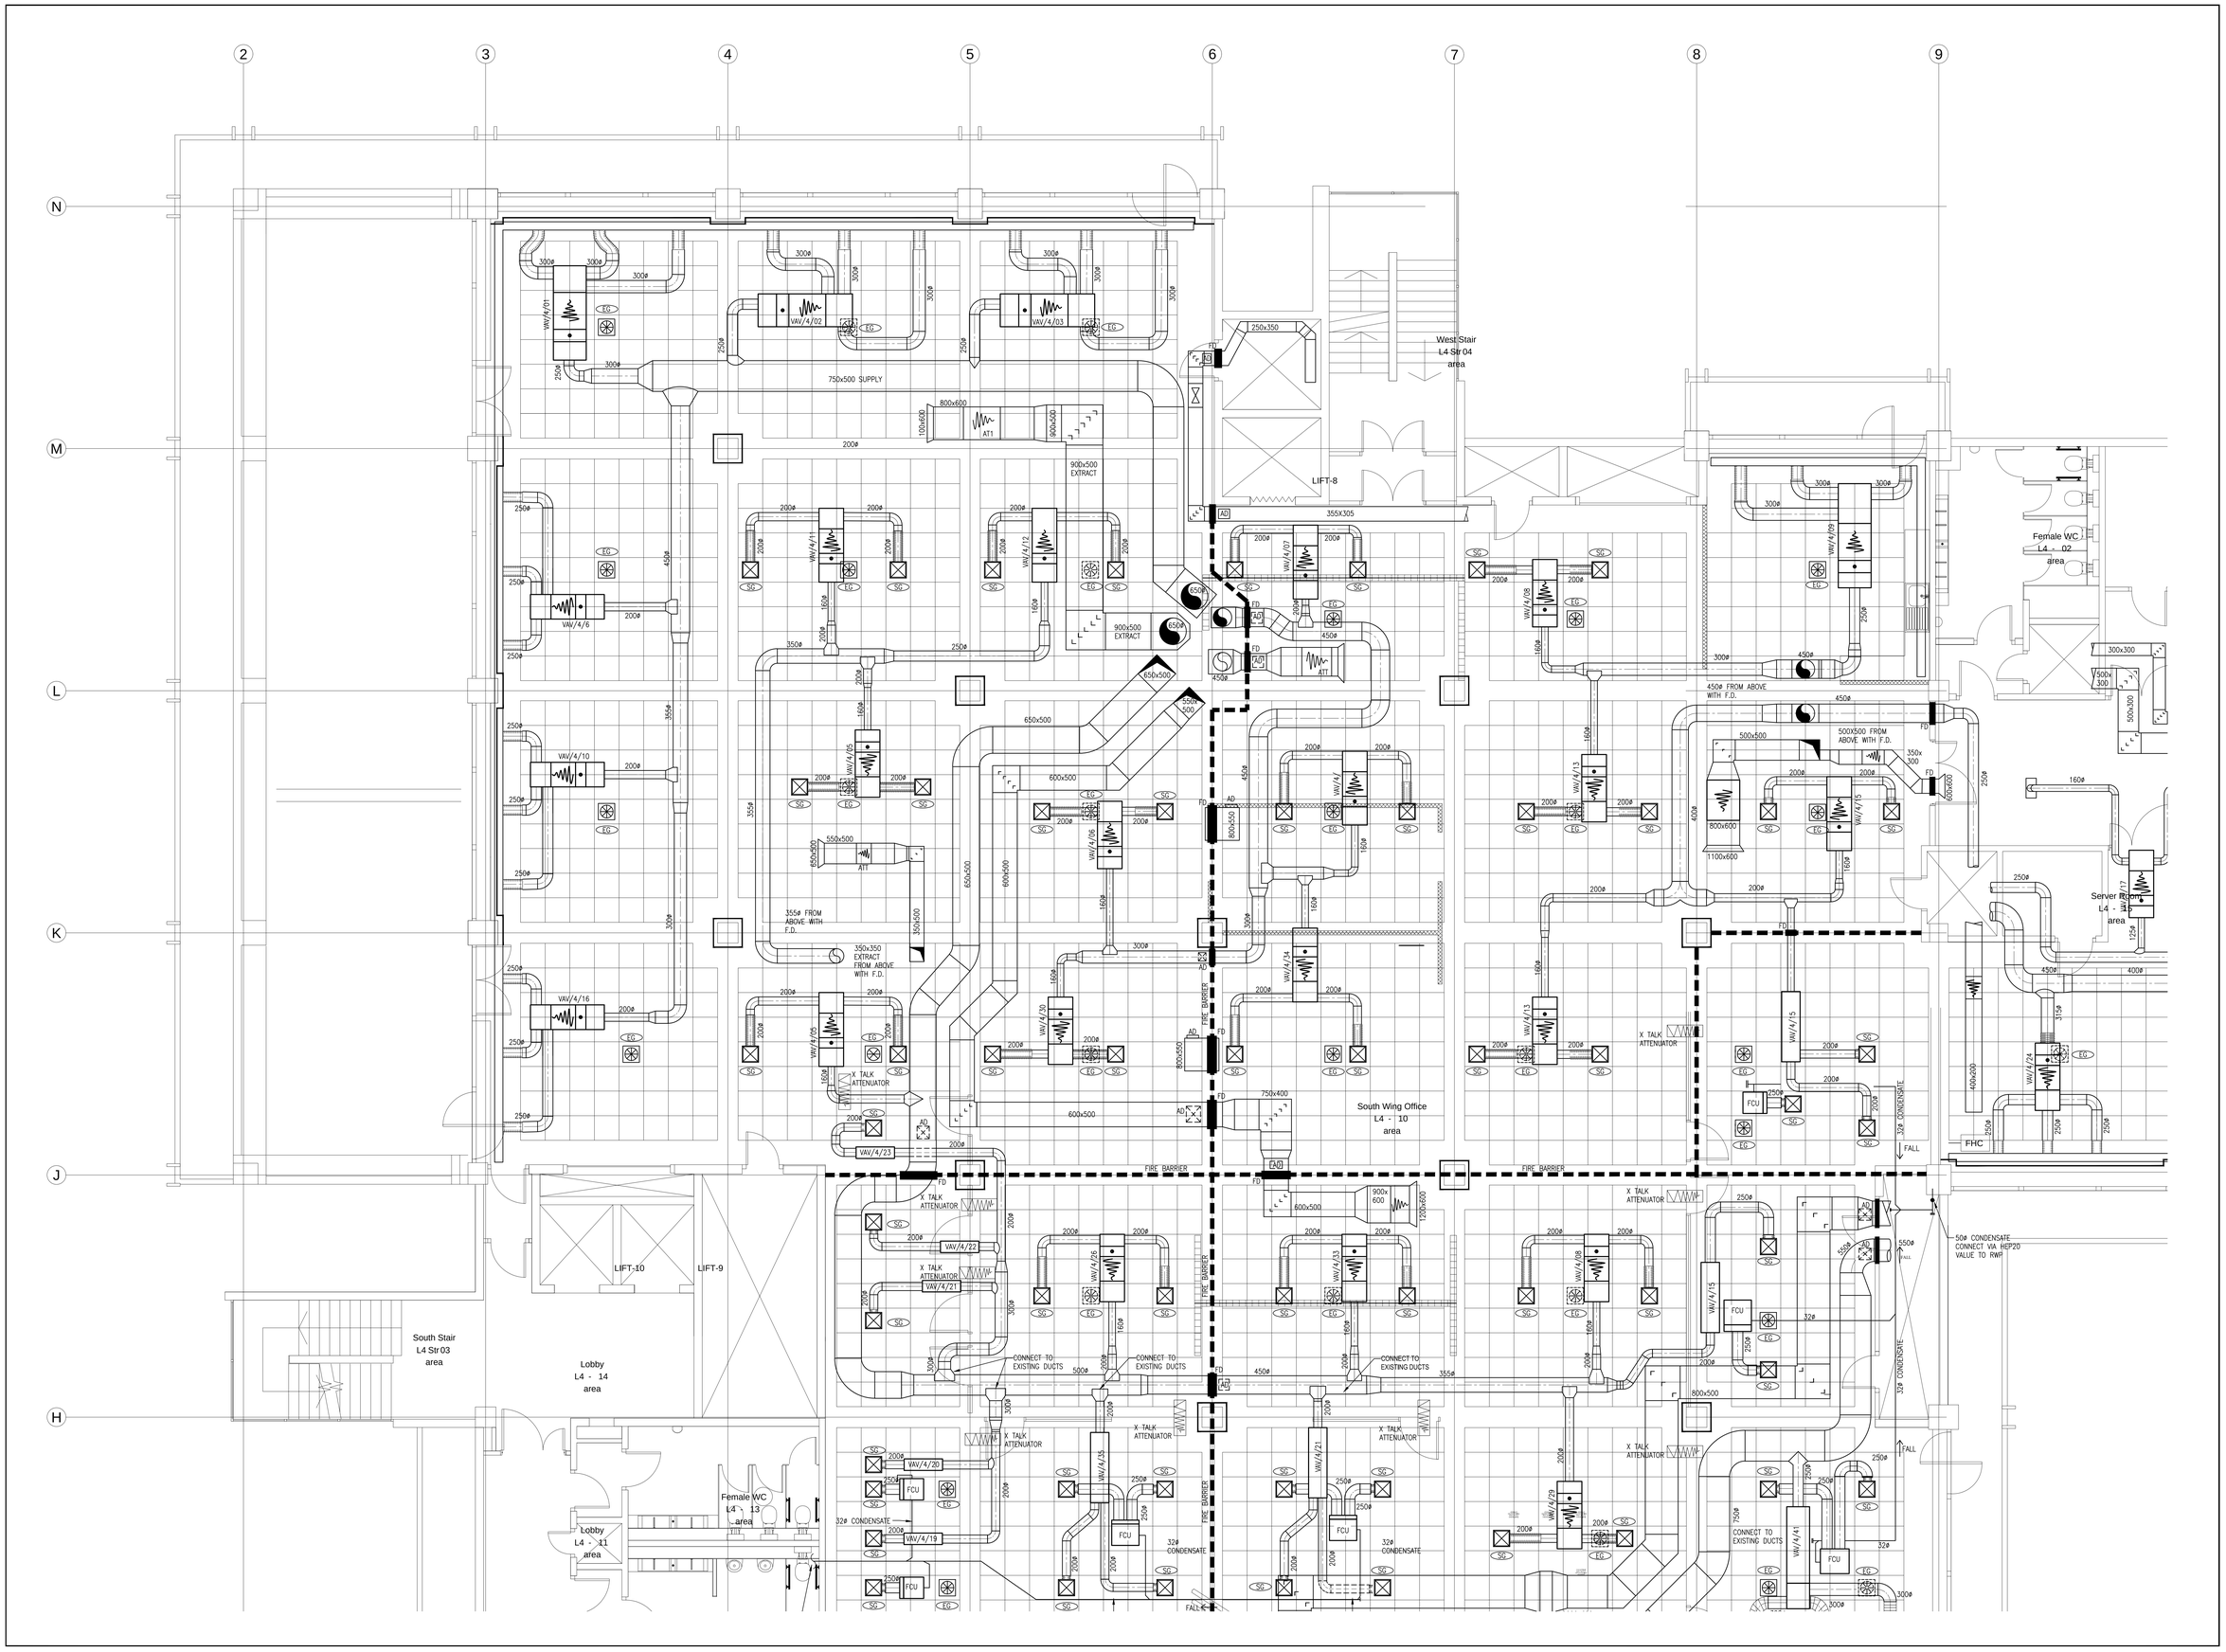

West Stair
L4 Str 04
area
LIFT-8
Female WC
L4 - 02
area
Server Room
L4 - 15
area
South Wing Office
L4 - 10
area
FIRE BARRIER
LIFT-10
LIFT-9
South Stair
L4 Str 03
area
Lobby
L4 - 14
area
Female WC
L4 - 13
area
Lobby
L4 - 11
area
750x500 SUPPLY
900x500
EXTRACT
355ø FROM
ABOVE WITH
F.D.
350x350
EXTRACT
FROM ABOVE
WITH F.D.
450ø FROM ABOVE
WITH F.D.
500X500 FROM
ABOVE WITH F.D.
X TALK
ATTENUATOR
CONNECT TO
EXISTING DUCTS
32ø CONDENSATE
50ø CONDENSATE
CONNECT VIA HEP20
VALUE TO RWP
FHC
FCU